
Cepac Facility, Faverdale Ind Est, Darlington, DL3 0PE
(24/09/2026) MP/JP

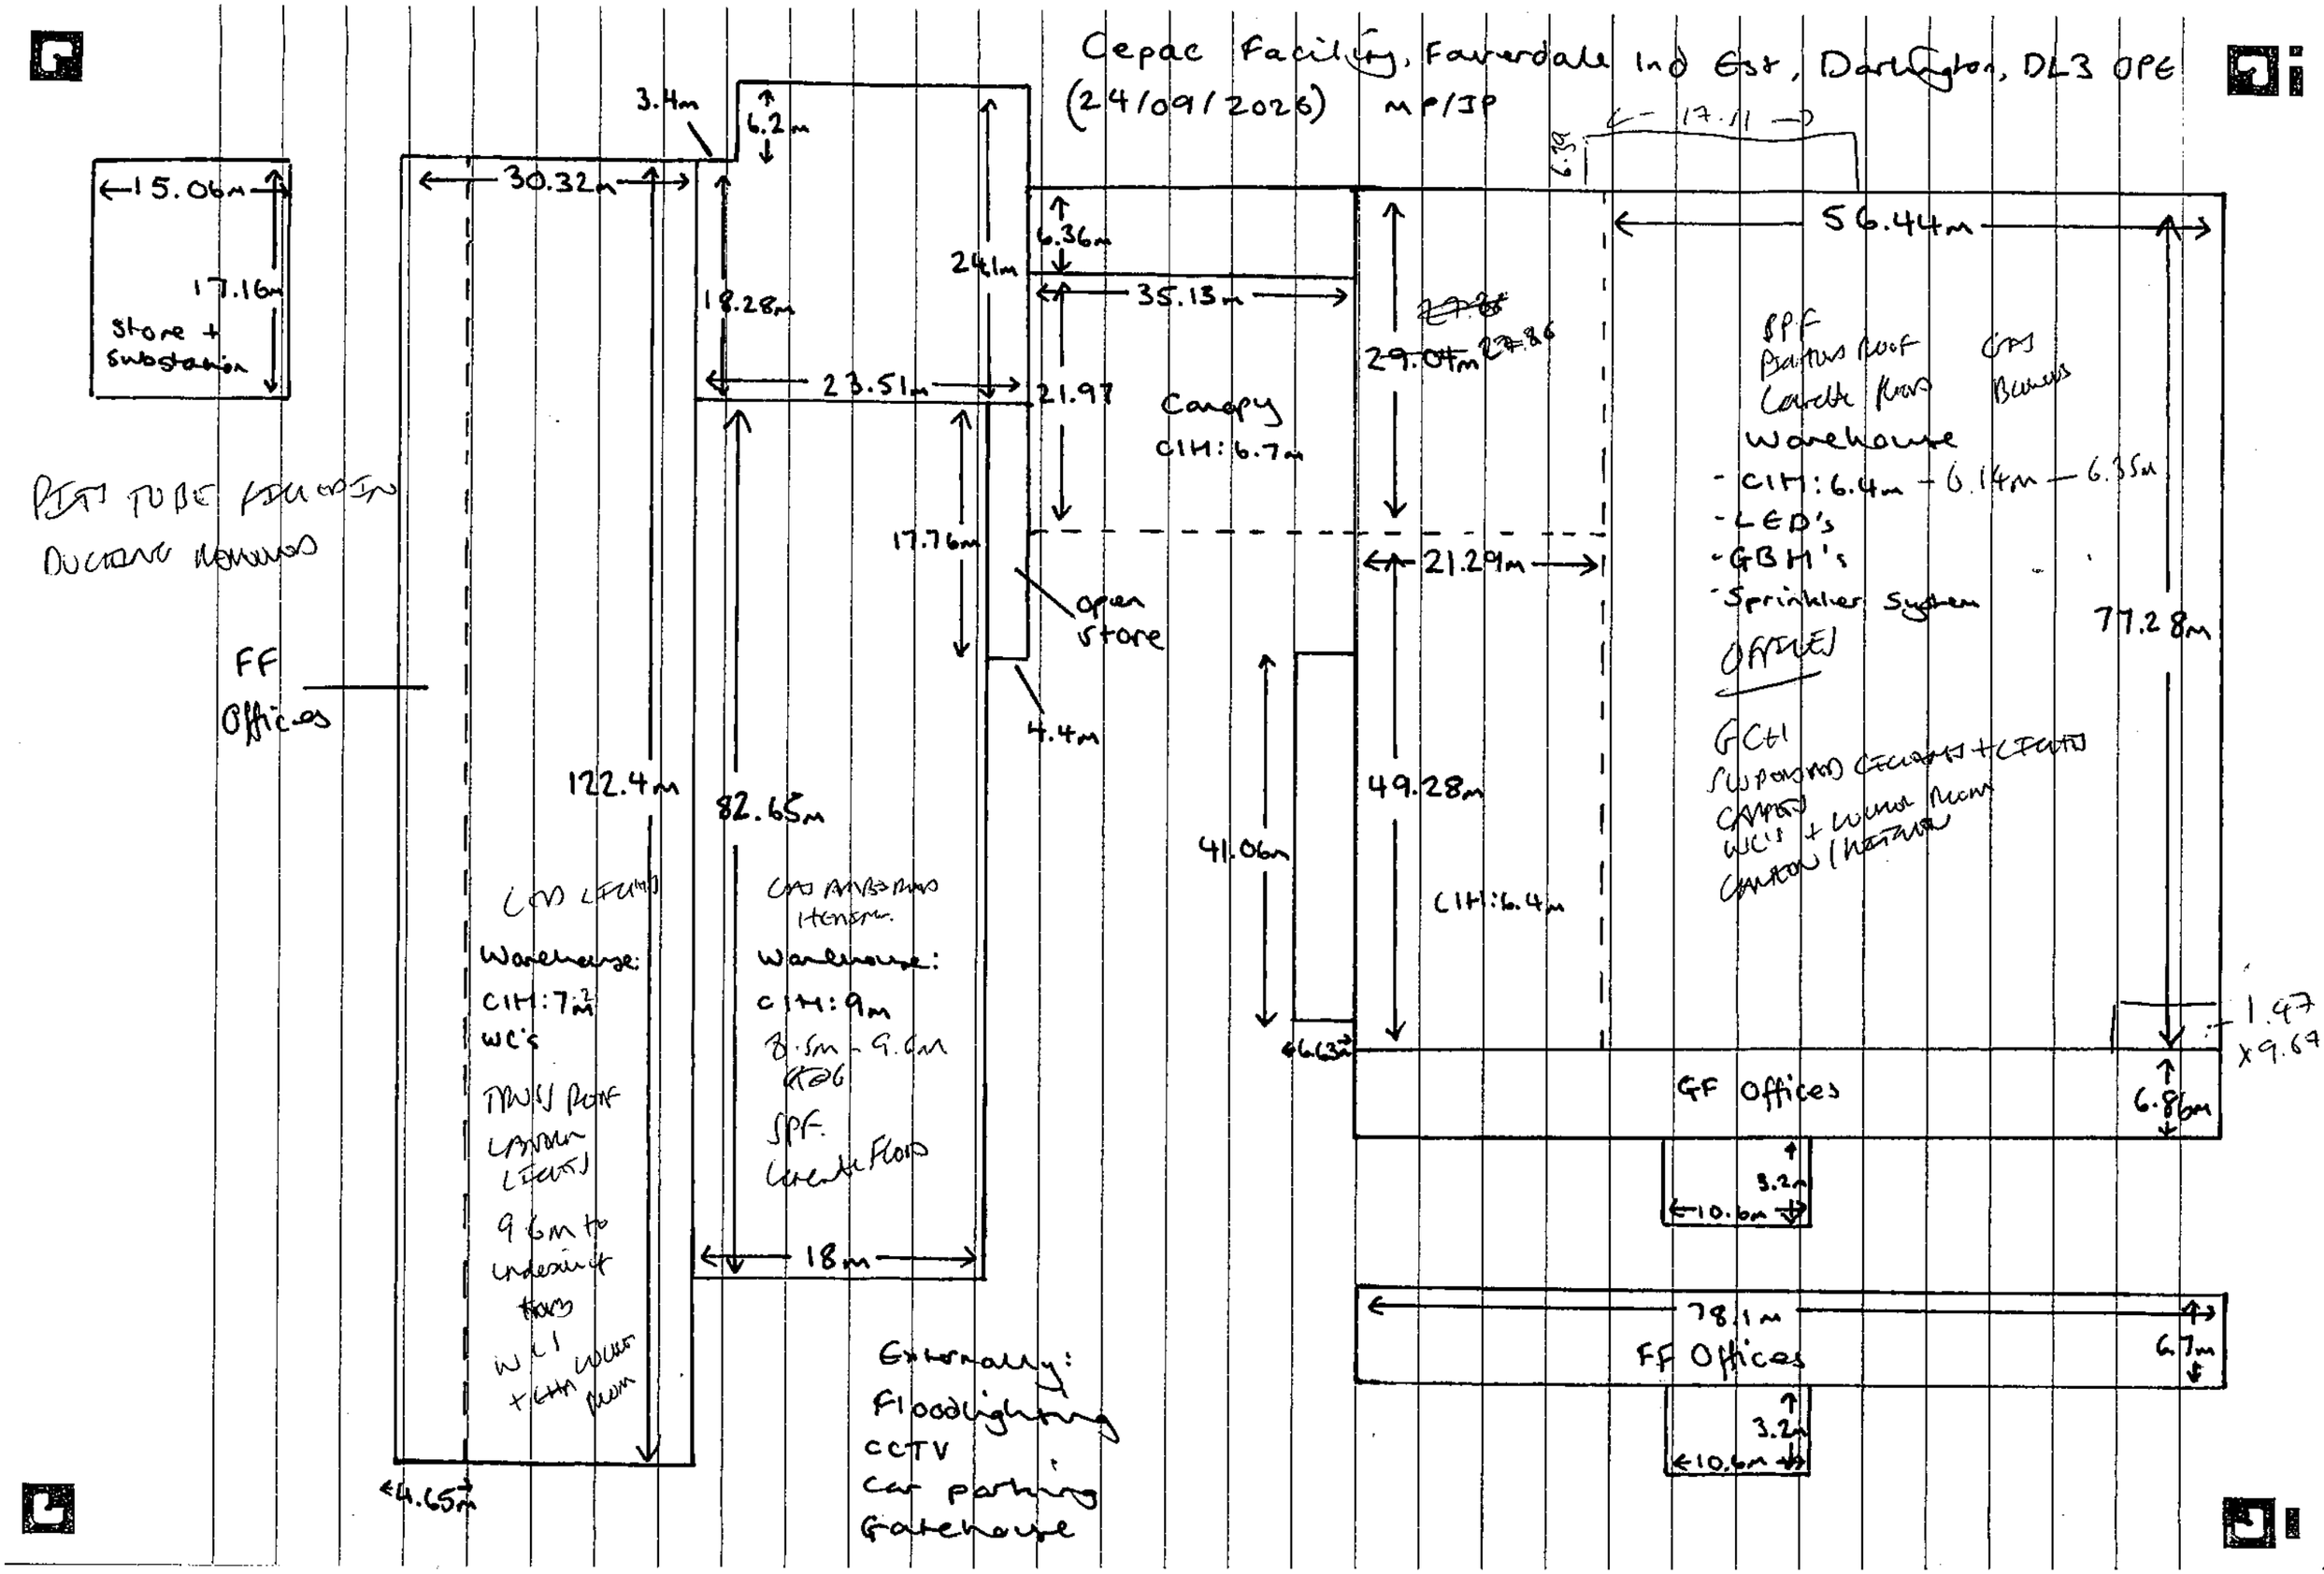

Cepac Facility, Faverdale Ind Est, Darlington, DL3 0PE
(24/09/2026) MP/JP

15.06m
17.16m
Store + substation

PIPE TUBE FOR CCTV DUCTWORK REMOVED

FF Offices

3.4m
6.2m
30.32m
18.28m
24.1m
6.36m
35.13m
23.51m
21.97
Canopy
clH: 6.7m
17.76m
open store
4.4m
21.29m
29.04m ~~29.85~~ 29.86
41.06m
49.28m
clH: 6.4m
4.63m

122.4m
82.65m
4.65m
18m

Low Level Warehouse:
clH: 7.2m
WC's
TPWS Roof Lighting Lights
9.6m to underside of truss
WC / Tea Room

Mezz Warehouse:
clH: 9m
8.5m - 9.6m AGL
SPF Concrete Floor

Externally:
Floodlighting
CCTV
Car parking
Gatehouse

17.11
6.39
56.44m
77.28m

SPF
Batten Roof
Concrete floor
GRP Panels
Warehouse
- clH: 6.4m + 6.14m - 6.35m
- LED's
- GBH's
- Sprinkler System
OFFICE

GCtl
Supporting Offices + CFA
Canteen
WC's + Locker Room
Canteen / Meeting Room

1.47
x 9.67

GF Offices
6.86m
3.2m
10.6m

78.1m
FF Offices
6.7m
3.2m
10.6m